

Pressure Relief Valve

Model 7000L/7200L

QUALITY COMPONENTS FOR FIRE SPRINKLER SYSTEMS


Pressure Relief Valves with Lock-Out for System Testing

AGF Manufacturing Model 7000L and 7200L pressure relief valves comply with the requirements of NFPA 13 that stipulates a pressure relief valve must be installed on all wet fire sprinkler systems downstream of any pressure reducing valve. Both models relieve excess system pressure caused by surges or temperature changes. They include a bronze body and stainless steel spring housed in a plastic casing that allows the user to temporarily lock it out to perform hydrostatic testing without removing the valve from the system.

The Model 7000L has a 1/2" MIPT inlet and FIPT outlet and is optional on our TESTANDRAIN models 1011A, 1011T, 2511A, and 2511T assemblies. The Model 7200L has a 3/4" MIPT inlet and FIPT outlet and is optional with our 1" Residential RiserPACK Model 8011. Both models are UL Listed and FM Approved, and come factory set at 175 PSI. The Model 7000L is also available in 200, 225 and 300 PSI.

Features:

- Temporarily Lock Closed to Allow Hydrostatic Testing Without Removing the Pressure Relief Valve from the System
- UL Listed
- FM Approved
- Factory-Set PSI:
 - Tested for Accuracy in Desired Range
 - Resistant to Tampering
 - Quickly Open to Flush Leak-Causing Debris



1011A




2511A




8011A

NOTE: UL and FM standards for sprinkler system pressure relief valves require relief valves to operate within a range of their ratings. FM requires a relief valve to OPEN at a pressure no less than 85% of their rating and UL requires OPENING at a pressure no greater than 105% of their rating. Both standards require the relief valves to CLOSE within a percentage below OPEN. Choose the relief valve comparing static pressure to 90% of the relief valve's rating to determine the estimated minimum OPENING and 80% of the relief valve's rating for approximate maximum CLOSING. The relief valve should be installed where it is easily accessible for maintenance. Care should be taken that the relief valve CANNOT be isolated from the system when the system is operational. A relief valve should NEVER have a shutoff valve or a plug downstream of its outlet.

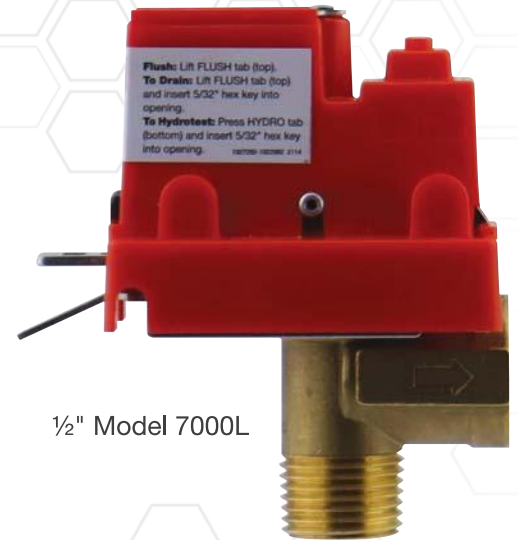

1/2" Model 7000L

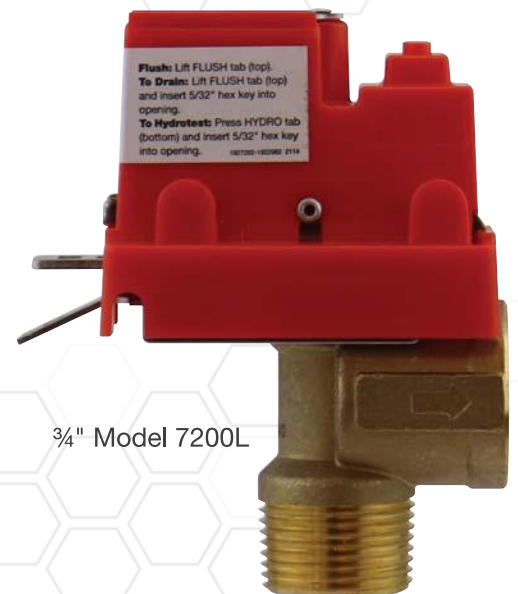

3/4" Model 7200L



Operation

The Model 7000L (1/2") and 7200L (3/4") are pressure relief valves specifically designed to relieve excess pressure caused by pressure surges or temperature changes in wet fire sprinkler systems. They comply with NFPA 13 requirements stipulating that a pressure relief valve be installed on all wet systems and downstream of all pressure reducing valves. These valves can be opened to flush debris from the seat, drain a system, or they can be temporarily locked closed for system hydrostatic testing.

Installation

To prevent damage to the valve when installing the M7000L or M7200L in the system, do not torque the valve into place using the valve cover! The valve must be installed using only the wrench flats provided on the valve's brass body.


Operation

The valve can be (1) manually opened for flushing operations; (2) manually locked open for draining operations and (3) manually locked close for system hydrostatic testing;

1. **Flushing:** Lift FLUSH tab (top).
2. **Draining:** Lift FLUSH tab (top) and insert 5/32" hex wrench into opening.
3. **Hydrotest:** Press HYDRO tab (bottom) down and insert 5/32" hex wrench into opening
OR


Hydrotest Alternative: Using a lock-out tag (field supplied), lift the HYDRO tab and tie to the FLUSH tab.

⚠ WARNING Remove hex wrench OR lock-out tag to restore valve to operating condition.

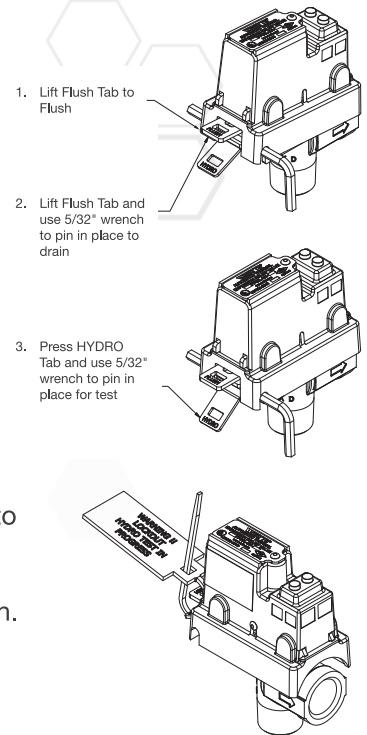


Dimensions

7000L

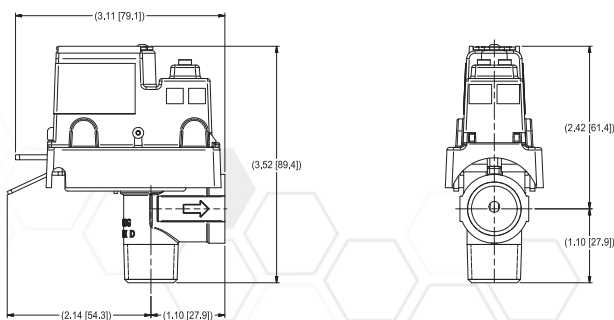

7200L

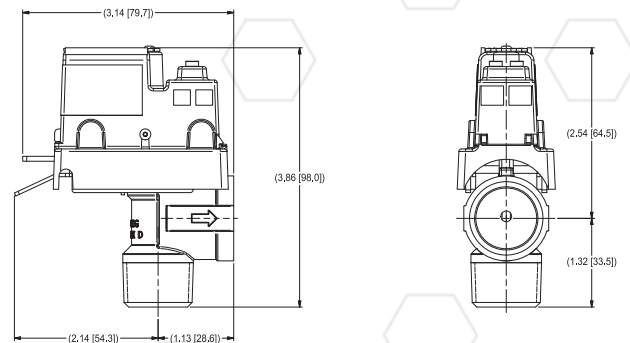

USA Patent and Other Patents Pending



AGF Manufacturing Inc.
100 Quaker Lane, Malvern, PA 19355

Phone: 610-240-4900
Fax: 610-240-4906

www.agfmfg.com

Job Name: _____

Architect: _____

Engineer: _____

Contractor: _____

M7000L, M7200L

Product Description

Model No	Valve Size		Rated Working Pressure	
	in	(mm)	psi	(kPa)
M7000L	1/2	(15)	300	(2070)
M7200L	3/4	(20)	300	(2070)

Factory set with a relief pressure between 175 and 300 psi (1210 to 2070 kPa), not field adjustable.

Details

Category	Trim Water Pressure Relief Valves, Fixed
Class of Work	1359 - Trim Water PRV (1/4th2-1/2)
Approval Standard	FM 1359 - Trim Water Pressure Relief Valves 1/4 Inch Through 2 1/2 Inch Nominal Size
Certification Type	FM Approved
Listing Country	United States of America

Company

AGF Manufacturing Inc
100 Quaker Lane, Malvern ,
Pennsylvania 19355
United States of America
<http://testandrain.com>



Valves, System Pressure Relief

COMPANY

EX4533

AGF MANUFACTURING INC

100 QUAKER LN

MALVERN, PA 19355-2479 United States

View model for additional information

Fixed, Model(s): [7000](#), [M7000L-175](#), [M7200L-175](#), [M7000L-200](#), [M7000L-225](#), [M7000L-300](#)

[Last Updated](#) on 2025-12-05

UL Solutions permits the reproduction of the material contained in Product iQ subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from Product iQ with permission from UL Solutions" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "©2026 UL LLC."