

Victaulic® FireLock™ Series FL-SR

Standard Coverage, Standard Response

Upright Pendent and Recessed Pendent Sprinklers, K2.8 (4.0), K4.2 (6.1), K5.6 (8.1), K8.0 (11.5)



1.0 PRODUCT DESCRIPTION

STANDARD RESPONSE UPRIGHT SPRINKLERS				
SIN	V2861	V4261	V2703	V3401
ORIENTATION	UPRIGHT	UPRIGHT	UPRIGHT	UPRIGHT
K-FACTOR ¹	2.8 Imp./4.0 S.I.	4.2 Imp./6.1 S.I.	5.6 Imp./8.1 S.I.	8.0 Imp./11.5 S.I.
CONNECTION	½" NPT/15mm BSPT	½" NPT/15mm BSPT	½" NPT/15mm BSPT/IGS	¾" NPT/20mm BSPT/IGS
MAX. WORKING PRESSURE	175 psi/1200 kPa	175 psi/1200 kPa	175 psi/1200 kPa cULus 250 psi/1725 kPa	175 psi/1200 kPa
RE-DESIGNATION	GL2861	GL4261	–	–
EQUIVALENT	–	–	GL5661	GL8164

STANDARD RESPONSE PENDENT SPRINKLERS						
SIN	V2851	V4251	V2707	V3405	V2763	V3701
ORIENTATION	PENDENT	PENDENT	PENDENT	PENDENT	PENDENT	PENDENT
K-FACTOR ¹	2.8 Imp./4.0 S.I.	4.2 Imp./6.1 S.I.	5.6 Imp./8.1 S.I.	8.0 Imp./11.5 S.I.	5.6 Imp./8.1 S.I.	8.0 Imp./11.5 S.I.
CONNECTION	½" NPT/ 15mm BSPT	½" NPT/ 15mm BSPT	½" NPT/ 15mm BSPT/IGS	¾" NPT/ 20mm BSPT/IGS	½" NPT/ 15mm BSPT/IGS	¾" NPT/ 20mm BSPT/IGS
MAX. WORKING PRESSURE	175 psi/1200 kPa	175 psi/1200 kPa	175 psi/1200 kPa cULus 250 psi/ 1725 kPa	175 psi/1200 kPa	175 psi/1200 kPa cULus 300 psi/ 2070 kPa	175 psi/1200 kPa
RE-DESIGNATION	GL2851	GL4251	–	–	–	–
EQUIVALENT	–	–	GL5651	GL8156	GL5651	GL8156
COMPARABLE TO	–	–	–	–	V2707, V2727	V3405, V3423

STANDARD RESPONSE RECESSED PENDENT SPRINKLERS						
SIN	V2851	V4251	V2707	V3405	V2763	V3701
ORIENTATION	PENDENT	PENDENT	PENDENT	PENDENT	PENDENT	PENDENT
K-FACTOR ¹	2.8 Imp./4.0 S.I.	4.2 Imp./6.1 S.I.	5.6 Imp./8.1 S.I.	8.0 Imp./11.5 S.I.	5.6 Imp./8.1 S.I.	8.0 Imp./11.5 S.I.
CONNECTION	½" NPT/ 15mm BSPT	½" NPT/ 15mm BSPT	½" NPT/ 15mm BSPT	¾" NPT/ 20mm BSPT	½" NPT/ 15mm BSPT	¾" NPT/ 20mm BSPT
MAX. WORKING PRESSURE	175 psi (1200 kPa)	175 psi/1200 kPa	175 psi/1200 kPa cULus 250 psi/ 1725 kPa	175 psi/1200 kPa	175 psi/1200 kPa cULus 300 psi/ 2070 kPa	175 psi/1200 kPa
ESCUTCHEON	Recessed	Recessed	Recessed	Recessed	Recessed	Recessed
RE-DESIGNATION	GL2851	GL4251	–	–	–	–
EQUIVALENT	–	–	GL5651	GL8156	GL5651	GL8156
COMPARABLE TO	–	–	–	–	V2707, V2727	V3405, V3423

¹ For K-Factor when pressure is measured in Bar, multiply S.I. units by 10.0.

ALWAYS REFER TO ANY NOTIFICATIONS AT THE END OF THIS DOCUMENT REGARDING PRODUCT INSTALLATION, MAINTENANCE OR SUPPORT.



1.0 PRODUCT DESCRIPTION (CONTINUED)

AVAILABLE GUARDS/SHIELDS					
SPRINKLER	V28	V42	V27	V34	V37
UPRIGHT			■	■	
PENDENT			■	■	■

AVAILABLE WRENCHES							
SPRINKLER	V56-2 Recessed	V56 Open End	V27-2 Recessed	V27 Open End	V34-2 Recessed	V34 Open End	3/16 Hex-Bit
V2861		■					
V4261		■					
V2703				■			■
V3401						■	■
V2851	■	■					
V4251	■	■					
V2707			■	■			■
V3405					■	■	■
V2763			■	■			■
V3701			■	■			■

Factory Hydrostatic Test: 100% @ 500 psi/3447 kPa/34 Bar
 100% @ 600 psi/4137 kPa/41 Bar - Applies to V2763 only

Min. Operating Pressure: UL/FM: 7 psi/48 kPa/.5 Bar
 VdS: 5 psi/35 kPa/.35 Bar (Upright only)

Temperature Rating: See tables in section 2.0 Certifications/Listings

2.0 CERTIFICATIONS/LISTINGS



104b/01
846b/01
104b/03
846b/03

0786

UPRIGHT APPROVALS/LISTINGS				
SIN	V2861	V4261	V2703	V3401
Nominal K Factor Imperial	2.8	4.2	5.6	8.0
Nominal K Factor S.I. ²	4.0	6.1	8.1	11.5
Orientation	UPRIGHT	UPRIGHT	UPRIGHT	UPRIGHT
Approved Temperature Ratings F°/C°				
cULus	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C 500°F/260°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C
FM	–	–	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C
LPCB	–	–	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C
VdS	–	–	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C
CE	–	–	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C
CCC	–	–	155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C	155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C

² For K-Factor when pressure is measured in Bar, multiply S.I. units by 10.

NOTES

- Reference the specific agency website listings for the most up-to-date certification information
- Where cULus Listed, Polyester and VC-250 Coatings Listed as Corrosion Resistant
- Where FM Approved, VC-250 Coating Approved as Corrosion Resistant
- New York City Acceptance - All UL Listed and/or FM Approved sprinklers acceptable to NYC per section 28-113 of the Administrative Code and the OTCR Rule

2.0 CERTIFICATIONS/LISTINGS (CONTINUED)



104b/01
846b/01
104b/03
846b/03

0786

PENDENT APPROVALS/LISTINGS						
SIN	V2851	V4251	V2707	V3405	V2763	V3701
Nominal K Factor Imperial	2.8	4.2	5.6	8.0	5.6	8.0
Nominal K Factor S.I. ²	4.0	6.1	8.1	11.5	8.1	11.5
Orientation	PENDENT	PENDENT	PENDENT	PENDENT	PENDENT	PENDENT
Approved Temperature Ratings F°/C°						
cULus	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C 500°F/260°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C
FM	–	–	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C
LPCB	–	–	–	–	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C
VdS	–	–	–	–	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C
CE	–	–	–	–	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C
CCC	–	–	155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C	155°F/68°C 200°F/93°C 286°F/141°C	155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C	155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C

² For K-Factor when pressure is measured in Bar, multiply S.I. units by 10.

NOTES

- Reference the specific agency website listings for the most up-to-date certification information
- Where cULus Listed, Polyester and VC-250 Coatings Listed as Corrosion Resistant
- Where FM Approved, VC-250 Coating Approved as Corrosion Resistant
- New York City Acceptance - All UL Listed and/or FM Approved sprinklers acceptable to NYC per section 28-113 of the Administrative Code and the OTCR Rule

2.0 CERTIFICATIONS/LISTINGS (CONTINUED)



104b/01
846b/01
104b/03
846b/03

0786

RECESSED PENDENT APPROVALS/LISTINGS						
SIN	V2851	V4251	V2707	V3405	V2763	V3701
Nominal K Factor Imperial	2.8	4.2	5.6	8.0	5.6	8.0
Nominal K Factor S.I. ²	4.0	6.1	8.1	11.5	8.1	11.5
Orientation	PENDENT	PENDENT	PENDENT	PENDENT	PENDENT	PENDENT
Escutcheon	Recessed	Recessed	Recessed	Recessed	Recessed	Recessed
Approved Temperature Ratings F°/C°						
cULus	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C
FM Both available with ½" and ¾" recessed escutcheon	–	–	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C
LPCB	–	–	–	–	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C
VdS	–	–	–	–	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C
CE	–	–	–	–	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C	135°F/57°C 155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C
CCC	–	–	155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C	155°F/68°C 200°F/93°C 286°F/141°C	155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C	155°F/68°C 175°F/79°C 200°F/93°C 286°F/141°C 360°F/182°C

² For K-Factor when pressure is measured in Bar, multiply S.I. units by 10.

NOTES

- Reference the specific agency website listings for the most up-to-date certification information
- Where cULus Listed, Polyester and VC-250 Coatings Listed as Corrosion Resistant
- Where FM Approved, VC-250 Coating Approved as Corrosion Resistant
- New York City Acceptance - All UL Listed and/or FM Approved sprinklers acceptable to NYC per section 28-113 of the Administrative Code and the OTCR Rule

3.0 SPECIFICATIONS – MATERIAL

Deflector: Bronze

Bulb Nominal Diameter: 5.0 mm

Load Screw: Bronze

Pip Cap: Bronze

Spring Seal: PTFE coated Beryllium nickel alloy

Frame: Brass

Lodgement Spring: Stainless steel

Installation Wrench: Ductile iron

Sprinkler Frame Finishes:

- Plain brass
- Chrome plated
- White polyester painted^{3, 4}
- Flat black polyester painted^{3, 4}
- Custom polyester painted^{3, 4}
- VC-250⁵


³ Not available on the Intermediate Level Style Pendant.

⁴ UL Listed for corrosion resistance.


⁵ UL Listed and FM Approved for corrosion resistance.

NOTES


- Weather-resistant escutcheon available upon request.
- For cabinets and other accessories refer to separate sheet.

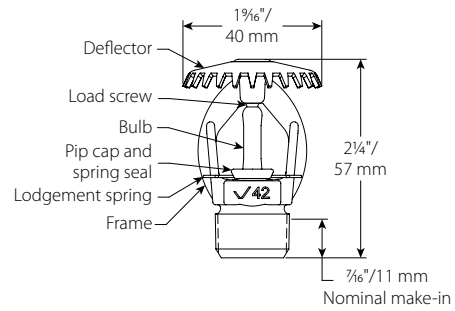


V2861, V4261

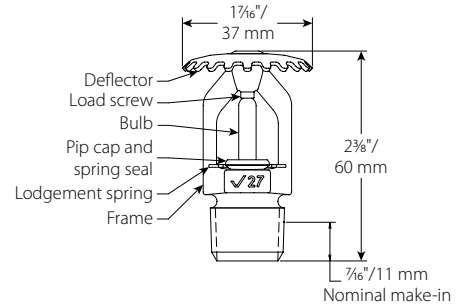


V2703

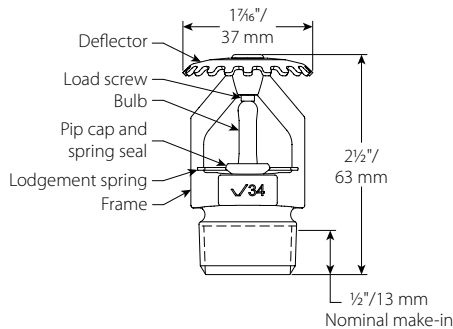


V3401

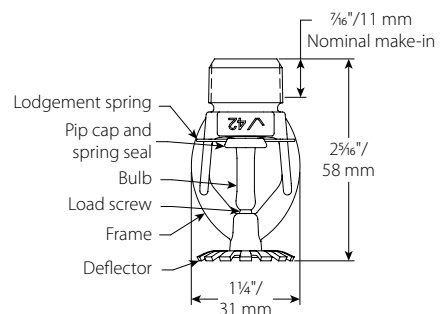

V2851, V4251

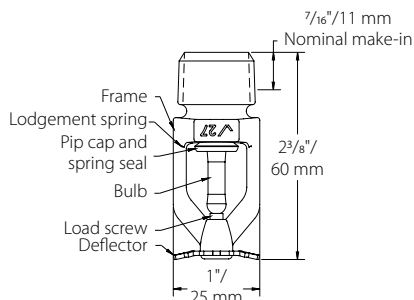


V2707, V2763

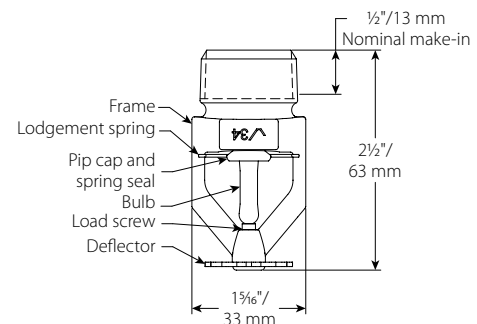


V3405


3.0 SPECIFICATIONS – MATERIAL (CONTINUED)

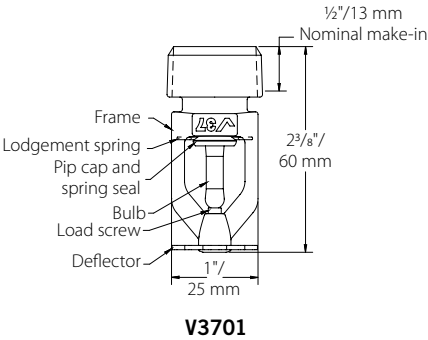


4.0 DIMENSIONS

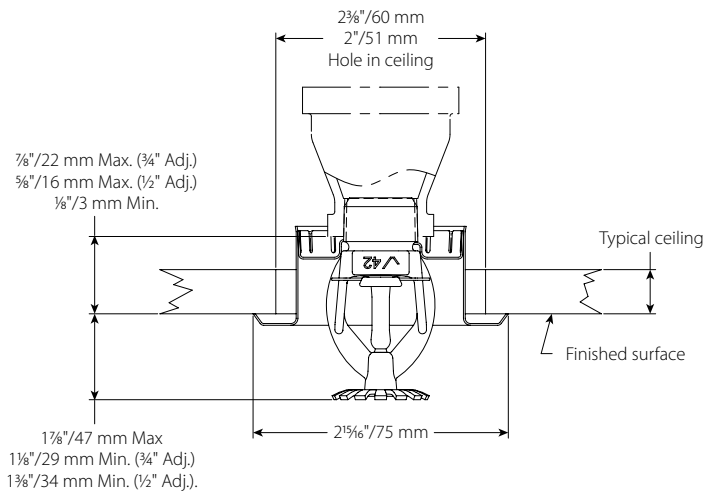

V2851, V4251

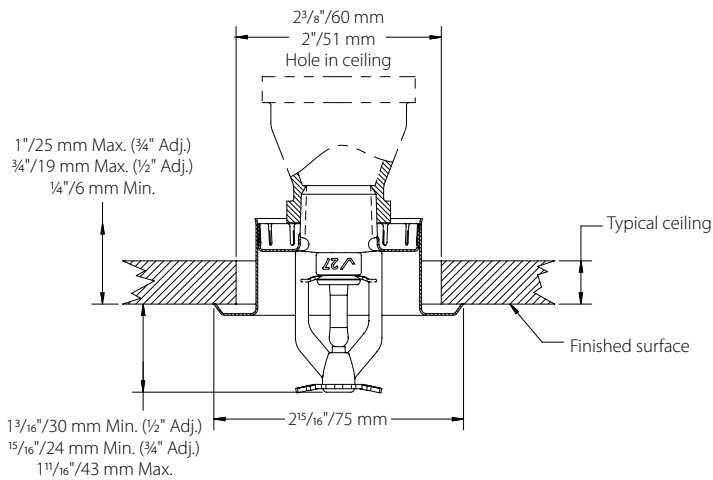


V2707, V2763

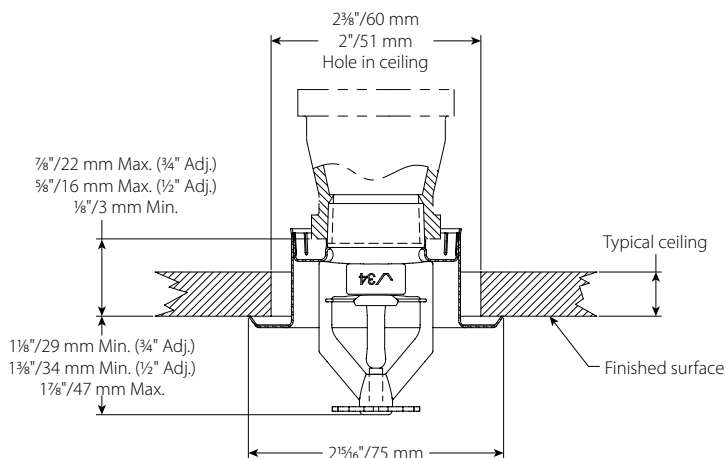

V3405

4.0 DIMENSIONS (CONTINUED)

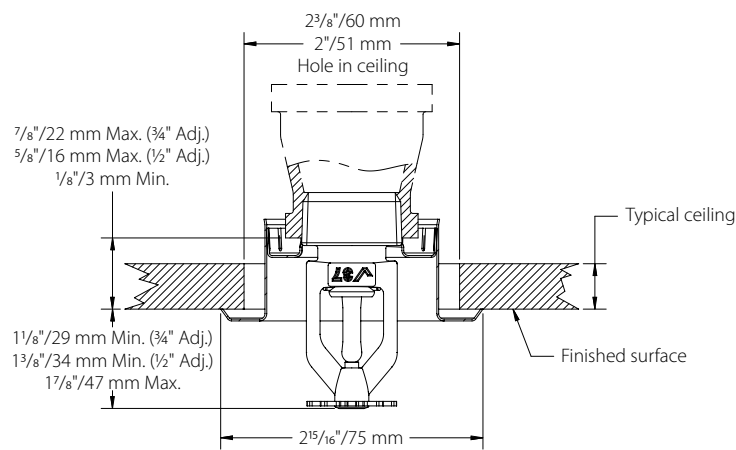

V3701

5.0 PERFORMANCE

Sprinkler systems are to be designed to and installed per NFPA, FM Datasheets, and any local standards.

6.0 NOTIFICATIONS

! WARNING



- Read and understand all instructions before attempting to install any Victaulic products.
- Always verify that the piping system has been completely depressurized and drained immediately prior to installation, removal, adjustment, or maintenance of any Victaulic products.
- Wear safety glasses, hardhat, and foot protection.

Failure to follow these instructions could result in death or serious personal injury and property damage.

- These products shall be used only in fire protection systems that are designed and installed in accordance with current, applicable National Fire Protection Association (NFPA) standards, or equivalent standards, and in accordance with applicable building and fire codes. These standards and codes contain important information regarding protection of systems from freezing temperatures, corrosion, mechanical damage, etc.
- The installer shall understand the use of this product and why it was specified for the particular application.
- The installer shall understand common industry safety standards and potential consequences of improper product installation.
- It is the system designer's responsibility to verify suitability of materials for use with the intended fluid media within the piping system and external environment.
- The material specifier shall evaluate the effect of chemical composition, pH level, operating temperature, chloride level, oxygen level, and flow rate on materials to confirm system life will be acceptable for the intended service.

Failure to follow installation requirements and local and national codes and standards could compromise system integrity or cause system failure, resulting in death or serious personal injury and property damage.

7.0 REFERENCE MATERIALS

Ratings: All glass bulbs are rated for temperatures from -67°F/-55°C.

[1-40: Victaulic FireLock™ Automatic Sprinklers Installation and Maintenance Instructions](#)

[1-V9: Style V9 Victaulic FireLock™ IGS™ Installation-Ready™ Sprinkler Coupling Installation Instructions](#)

User Responsibility for Product Selection and Suitability

Each user bears final responsibility for determining the suitability of Victaulic products for their end-use application, in accordance with industry standards, project specifications, and Victaulic's published performance, maintenance, and safety data, as well as all warnings and installation instructions. Nothing in this or any other document, nor any verbal recommendation, advice, or opinion from any Victaulic employee, shall be deemed to alter, vary, supersede, or waive any provision of Victaulic Company's standard conditions of sale, warranty, installation instructions, or this disclaimer.

Installation

Always refer to and follow the [Victaulic Installation Handbook](#) or installation instructions for the product you are installing. Handbooks are included with each shipment of Victaulic products, providing complete installation and assembly data, and are available in PDF format on our website at [victaulic.com](#).

Warranty

Refer to the Warranty section of the current Price List or contact Victaulic for details.

Intellectual Property Rights

No statement concerning the use of any material, product, service, or design is intended, or should be construed, to grant any license under any patent or other intellectual property right of Victaulic or any of its affiliates, or as a recommendation for the use of such material, product, service, or design in the infringement of any patent or other intellectual property right. The terms "Patented" or "Patent Pending" refer to design or utility patents or patent applications for articles and/or methods of use in the United States and/or other countries. Victaulic and all other Victaulic marks are the trademarks or registered trademarks of Victaulic Company, and/or its affiliated entities, in the U.S. and/or other countries.

Note

All products bearing a Victaulic trademark are manufactured by Victaulic or to Victaulic specifications. All products are to be installed only in accordance with the applicable Victaulic installation instructions. Victaulic reserves the right to change product specifications, designs and standard equipment without notice and without incurring obligations.

SIN V3701

File Number: EX5170

COMPANY

Victaulic Company
4901 Kesslersville Rd
Easton, PA 18040-6714 United States

SIN INFO

V3701
Glass Bulb Type

ATTRIBUTES

Response Type	Sprinkler Type	Nom K-Factor, gpm/vpsi (L/min/vbar)	System Working Pressure	Corrosion Resistant
QR	Standard-Spray Sprinklers, Upright And Pendent	8.0 (115)	175 psig (1.2 Mpa)	Non-Wax Coatings - See installation instructions

GENERAL

Inlet Connection

3/4 in. NPT, Other - See installation instructions

STANDARD-SPRAY SPRINKLERS, UPRIGHT AND PENDENT

Type	Sprinkler Temp Rating, °F (°C)	Cover Temp Rating, °F (°C)
Pendent	135 (57), 155 (68), 175 (79), 200 (93), 286 (141), 360 (182)	Not Applicable

Report Date: 1998-12-14
Revision Date: 2026-05-15



Sprinklers | Non-Storage Sprinklers | **Non-Storage Sprinklers**

V3701

Details

Category	Non-Storage Sprinklers
Class of Work	2001 - AS, Ctrl Mode (nom K=8.0)
Approval Standard	FM 2000 - Automatic Sprinklers for Fire Protection
Certification Type	FM Approved
K	8.0
K (metric)	115
Coverage Type	Standard
Type	Pendent
Response	SR - Standard Response
Element	5 mm
NPT (in.)	3/4
Finish	Chrome, Polyester, VC-250, Brass
Temp. Rating (°F)	135, 155, 175, 200, 286, 360
Temp. Rating (°C)	57, 68, 79, 93, 141, 182
Sprinkler Category	Non Storage
Use with Vacuum System	No
Grooved Connection	Yes
Listing Country	United States of America

Company

Victaulic Company
4901 Kesslersville Rd, Easton ,
Pennsylvania 18040
United States of America
<http://victaulic.com>